

## Quick Start

- 1. Unscrew the battery cover and install (2) AA alkaline batteries.
- 2. Hold 妙 to power on.
  Wireless setting is briefly displayed (ON/OFF).
- 3. Connect to the equipment you're evacuating. Connect directly to an unused service port or to a Schrader valve core removal tool.
- 4. View the live measurement on the top line. Activate wireless in the menu to send measurements to compatible Job® Link system tools.
- 5. Press **NEXT** to change bottom line view.

#### What's Included

- (1) MG44 Wireless Vacuum Gauge
- (1) 1/4" SAE 45° coupler w/depressors
- (2) AA Batteries
- (1) Operator's manual
- (1) Year limited warranty

## Description

Use the MG44 Wireless Vacuum Gauge to reliably monitor your evacuations in the field. Long range wireless technology sends deep vacuum measurements up to 1000 feet (305 meters) away. View live on your SMAN™ manifold, in the Job Link® mobile app, or directly on the MG44.

Save time by wirelessly monitoring your evacuations. Remotely view trending on the Job Link mobile app so you know when an extra nitrogen purge is required, a leak is suspected, or just watch everything pull as planned.

Reduce the misleading nature of dynamic vacuum measurement during pull down by connecting MG44 directly to the system. The assymetrically angled, reversible coupler makes it easy to orient the gauge so that it's out of the way and easy to see.

Select one of three unique views, including a new Rate Meter that provides a great feel. Built for demanding field use, the overmolded case resists damage from physical impact and water ingress.

## Maintenance

**CLEANING:** Clean the exterior with a damp cloth. Do not use detergents or solvents.

**SENSOR:** Clean the sensor on a regular basis to prevent the build up of oils and contaminents. <u>DO NOT use an object such as a cotton swab to clean the sensor. This may damage the sensor.</u>

- 1. Power off MG44.
- If attached, remove the coupler from MG44 to expose the cavity of the 1/4" male fitting.
- Fill up about half of the cavity with isopropyl (rubbing) alcohol or RX-11 flush.
- Cover the cavity with a finger or a sealed cap and gently shake it for about 15-30 seconds.
- 5. Pour out the dirty solution and let the vacuum sensor dry with the fitting facing down.

**BATTERIES:** An empty battery icon indicates batteries need replaced. When power is too low to operate, "**LoBatt**" is displayed 5 sec before powering off automatically. You can also monitor battery life in the Job Link app tool manager.

- 1. Power off MG44.
- 2. Uncrew the battery cover (2 screws).
- 3. Install (2) new alkaline AA batteries.
- 4. Reinstall cover.

## Specifications

Minimum Device Requirement:

BLE 4.0 devices running iOS® 7.0 or Android™ 5.0 (Latest compatibility at www.fieldpiece.com)

**Connector Type:** 1/4" SAE male fitting. Includes reversible 45° assymetrical coupler with Schrader depressors.

Max Pressure: 870 psig (60 bar) Refresh Rate: 0.5 seconds

**Accuracy:**  $\pm$ (5% reading + 5 micron) at 77°F(25°C), 50 to 1000 micron

Range and Units:

50 to 25000 micronHg (mTorr); 0.05 to 25 mmHg (Torr); 6 to 3333 Pascals; 0.06 to 33.33 mBar

#### **Best Resolution:**

1 micronHg(mTorr), below 2000; 0.001 mmHg (Torr), below 2.5; 1 Pascal, below 250; 0.001 mBar, below 2.5;

Battery Type: 2 x AA Alkaline, NEDA 15A, JIS UM3, IEC LR6

Battery Life: 50 hours typical alkaline

**Auto Power Off:** 15 minutes default (APO adjustable) **Wireless Range:** 1000 feet (305 meters) line of sight.

Obstructions affect distance. **Radio Frequency:** 2.4 GHz **Water Resistence:** IP54

**Operating Environment:** 14°F to 122°F (-10°C to 50°C) at <75%RH

**Storage Temperature:**  $-4^{\circ}F$  to  $140^{\circ}F$  ( $-20^{\circ}C$  to  $60^{\circ}C$ ) at <80%RH (with batteries removed)

**Weight:** 0.66 lbs (300 g)

**US Patent:** www.fieldpiece.com/patents

# Operation

### **Buttons**

Unless muted, each button press triggers a beep. An inactive button press triggers a double beep.



Hold to toggle power. Toggle backlight. *Silence alarm*.



Hold to enter **MENU**. Hold to exit **MENU** without saving.

**ENTER** selection.

 $Stop \ low \ alarm \ and \ start \ high \ alarm.$ 




**NEXT** menu item or increase value. Hold to toggle **ALARM** mode. Silence alarm.

**NEXT** view.

### **Display**

In standard operating mode, the top line shows the live measurement. The bottom line shows one of three selectable views.

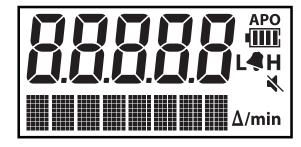

**APO**: Auto Power Off Enabled

: Battery Level

L : Low Alarm

🥊 📙 ∶ High Alarm

: Muted

 $\Delta$ /min : Rate (differential per minute)

• 11 OFF: Wireless Disabled (shown at startup)

#### **Views**


Press **NEXT** to change the content of the bottom line. Each view provides a unique way to monitor your evacuation.

**RATE:** The running 10-second average of the measurement's change per minute. Negative rates indicate the vacuum is getting deeper.

**RATE METER:** The graphical representation of the measurement's real-time change per minute. The scale is dynamic (i.e. relative to the measurement) making changes easy to see.



**BAR GRAPH:** The graphical representation of the measurement. The scale is static and nonlinear for increased resolution at deeper vacuums. Full bars indicates atmospheric pressure.



~3500 micronHg

### **Alarm Mode**

Every evacuation is different. Some require multiple purges of dry nitrogen, while some take less time than a phone call. Activate alarm mode so you can get other things handled without babysitting your gauge.

Follow recommended evacuation practices from the equipment manufacturer and training. Alarm levels can be adjusted in the menu.

- 1. Hold **ALARM** to activate\* low alarm (**L**). Stopwatch starts. APO deactivates. Turn on your vacuum pump.
- 2. Once the low alarm level is reached, the backlight blinks and the alarm sounds.

  To silence the alarm, press 少 or **NEXT**.

  Isolate the vacuum pump from the system.
- 3. Press **ENTER** to activate high alarm (**H**). Stopwatch restarts.
- 4. Once the high alarm level is reached, the backlight blinks and the alarm sounds.

  To silence the alarm, press 少 or **NEXT**.

  Stopwatch stops.
- Press ENTER to exit alarm mode. APO reactivates.
- \* Hold **ALARM** to exit alarm mode at any time.

# **Evacuation Tips**

- Remove Schrader valve cores with a removal tool.
- Remove valve depressors from hoses.
- Use shortest vacuum rated hoses with largest diameter available.
- Do not evacuate through hoses with low loss fittings.
- Inspect the rubber seals at both ends of your hoses for damage.
- Change pump oil before and during the job.
   Change pump oil on-the-fly without losing vacuum with Fieldpiece vacuum pumps.
- When the vacuum pump is isolated from the system, a slow rise that stabilizes may signify moisture is still present in the system. A continuous rise to atmosphere indicates a leak. Check hoses, tools, or the system itself.
- Measurements are less representative of the entire system when the vacuum pump is on because pumping creates a pressure gradient. Isolate the pump and allow the system to stabilize before assuming the measurement represents the entire system.

1

## Settings Menu

The settings menu can be entered when in standard operating mode. Selecting a new setting automatically exits the menu. This saves time getting in and out of the menu guickly for your most commonly changed setting (e.g. wireless).

- 1. Hold **ENTER** to enter\* the settings menu. The menu starts where you last exited.
- 2. Press **NEXT** to view next setting. The menu loops so keep going if you skipped the setting you want to change.
- 3. Press **ENTER** to select the setting.
- 4. Press **NEXT** to increase the setting value. The setting values loop so keep going if you skipped the value you want to save.
- 5. Press **ENTER** to save\* the new value and exit.
- \* Hold **ENTER** to exit the menu without saving.

### **List of Settings**

**Start : :** Enable Wireless (if off) **Stop • 1** : Disable Wireless (if on)

**Auto Off**: Set Auto Off Timer

Units : Set Unit of Measure

**Alarm Lo**: Set Low Alarm Level

**Alarm Hi**: Set High Alarm Level

Mute : Enable Speaker (if off) : Disable Speaker (if on) Unmute

**BkLtTime**: Set Backlight Timer

**Firmware**: View and Update Firmware

: Restore Default Settings Restore

FCC Statement

interference in a residential installation.

This equipment has been tested and found to comply with the limits

for a Class B digital device, pursuant to Part 15 of the FCC Rules. These

limits are designed to provide reasonable protection against harmful

### High Alarm Level (♣H)

Set the vacuum level required to trigger the high alarm. Hold **NEXT** for guicker scrolling. (Low Alarm - 1000 - 9000)

### Mute (≺)

Mute or unmute the speaker. Button presses and alarms remain silent if the speaker is muted. The \(\bigcirc\) icon appears if the speaker is muted.

### **Backlight Timer**

Set the timer for the backlight automatically turning off. The timer is reset when a button is pressed.

(10s, 20s, 1min, 2min, 5min, 10min, 15min, 30min)

#### **Firmware**

Check the firmware version (X.XXX.X) and the wireless region (X.XXX.X) installed.

If a new version is available from the Job Link mobile app, initiate the update from your mobile device. If installation is successful, "Done" is displayed and powers off. If battery life is too low to complete the installation, "Low Batt" is displayed and powers off. If the update fails, "Error" is displayed and powers off.

#### Restore

To restore all settings to their factory defaults, press **NEXT** until "YES" is displayed and press **ENTER** to confirm. To exit without restoring, select "no" or hold ENTER.

# Certifications and Module IDs







Waste Electrical and Electronic Equipment

Restriction of Hazardous

**IFETEL: Federal Telecom Institute** 

**Substances Compliant** 

RCPFI2A18-0235



IC: Industry Canada 22518-BT003



This equipment generates, uses and can radiate radio frequency Regulatory Compliance Mark energy and, if not installed and used in accordance with the instructions,

may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one of the following measures:

- . Reorient or relocate the receiving antenna.
  - . Increase the separation between the equipment and receiver.
  - . Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
  - . Consult the dealer or an experienced radio/TV technician for help.

FCC Caution: To assure continued compliance, any changes or modifications not expressly approved by the party responsible for compliance could void the user's authority to operate this equipment. (Example - use only shielded interface cables when connecting to computer or peripheral devices).

This device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) this device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

This device complies with Industry Canada licence-exempt RSS-247 standard. Operation is subject to the following two conditions: (1) this device may not cause interference, and (2) this device must accept any interference, including interference that may cause undesired operation of the device.

Wireless \*\*

Units

unit setting.

Start or stop sending wireless measurements.

Live measurements can be sent to SMAN

manifold (overrides its internal vacuum gauge),

and to the Job Link mobile app for added

capabilities such as live trending. Wireless is

Set the timer for the gauge automatically

powering off. The timer is reset when a button

is pressed. The timer is disabled in alarm mode.

Set the unit of vacuum measurement. Alarm

Set the vacuum level required to trigger the

levels are automatically converted to match the

(Microns, Pascals, mBar, mTorr, Torr, mmHg)

low alarm. Hold **NEXT** for guicker scrolling.

Low Alarm Level (∟◆)

(50 - 500 - High Alarm)

(15min, 30min, 45min, 60min, Disabled)

disabled by default to maximize battery life.

**Auto Power Off Timer (APO)** 

IC Radiation Exposure Statement: This equipment complies with IC RSS-102 radiation exposure limit set forth for an uncontrolled environment. This equipment should be installed and operated with minimum distance 0.5 cm between the radiator and your body. Fieldpiece Instruments 1636 West Collins Avenue, Orange, CA 92867

## IFETEL Statement

La operación de este equipo está sujeta a las siguientes dos condiciones: (1) es posible que este equipo o dispositivo no cause interferencia perjudicial y (2) este equipo o dispositivo debe aceptar cualquier interferencia, incluyendo la que pueda causar su operación no deseada.

The operation of this equipment is subject to the following two conditions: (1) this device or device may not cause harmful interference, and (2) this device or device must accept any interference, including interference that may cause undesired operation.

## **ANATEL Statement**

Este equipamento não tem direito à proteção contra interferência prejudicial e não pode causar interferência em sistemas devidamente

This equipment is not subject to the protection from harmful interference and may not cause interference with duly authorized

# Limited Warranty

This probe is warranted against defects in material and workmanship for one year from date of purchase from an authorized Fieldpiece dealer. Fieldpiece will replace or repair the defective unit, at its option, subject to verification of the defect.

This warranty does not apply to defects resulting from abuse, neglect, accident, unauthorized repair, alteration, or unreasonable use of the instrument.

Any implied warranties arising from the sale of a Fieldpiece product, including but not limited to implied warranties of merchantability and fitness for a particular purpose, are limited to the above. Fieldpiece shall not be liable for loss of use of the instrument or other incidental or consequential damages, expenses, or economic loss, or for any claim of such damage, expenses, or economic loss.

State laws vary. The above limitations or exclusions may not apply to you.

### **Obtaining Service**

For international customers, warranty for products purchased outside of the U.S. should be handled through local distributors. Visit our website to find your local distributor.



© Fieldpiece Instruments, Inc 2021; v01